

SPONSOR: **ARTIZIN™**  
Garland, TX

**Sound Absorption**  
**RAL™-A22-488**

CONDUCTED: 2022-11-08  
ON: ArtFelt™ Connex Cloud

Page 1 of 8

### TEST METHODOLOGY

Riverbank Acoustical Laboratories™ is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2017 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-22: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-16: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request. The results presented in this report apply to the sample as received from the test sponsor.

### INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as ArtFelt™ Connex Cloud. The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

#### **Product Under Test**

---

Product Name: ArtFelt™ Connex Cloud  
Core Material: PET  
Thickness: 9mm  
Manufacturer: ARTIZIN™

### SPECIMEN MEASUREMENTS & TEST CONDITIONS

Through a full external visual inspection performed on the test specimen, Riverbank personnel verified the following information:

#### **Test Specimen**

---

Product Type: Baffle cloud  
Dimensions: 1194 mm (47 in.) by 1829 mm (72 in.)  
Depth: 305 mm (12 in.)  
Thickness: 9.63 mm (0.379 in.)  
Overall Weight: 10.43 kg (23 lbs)

1512 S BATAVIA AVENUE  
GENEVA, IL 60134  
630-232-0104

## Test Report

[www.riverbankacoustics.com](http://www.riverbankacoustics.com)

FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

ARTIZIN™  
2022-11-08

RAL™-A22-488  
Page 2 of 8

### Physical Measurements (per object)

Dimensions: 1.19 m (47.0 in) wide by 1.83 m (72.0 in) long

Thickness: 0.3 m (12.0 in)

Weight: 10.43 kg (23.0 lbs)

### Test Environment

Room Volume: 291.98 m<sup>3</sup>

Temperature: 21.1 °C ± 0.1 °C (Requirement: ≥ 10 °C and ≤ 5 °C change)

Relative Humidity: 59.55 % ± 2.5 % (Requirement: ≥ 40 % and ≤ 5 % change)

Barometric Pressure: 100.0 kPa (Requirement not defined)

The array of objects covered 2.18 m<sup>2</sup> (23.5 ft<sup>2</sup>) of the horizontal test surface (total treated area).

### MOUNTING METHOD

Type J Mounting: The specimen is a sound absorbing object suspended from cables such that the closest face is located approximately 1448 mm (57 in.) from the horizontal test surface. This approximates the mounting method of a typical installation.

1512 S BATAVIA AVENUE  
GENEVA, IL 60134  
630-232-0104

**Test Report**

[www.riverbankacoustics.com](http://www.riverbankacoustics.com)

FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

**ARTIZIN™**  
2022-11-08

**RAL™-A22-488**  
Page 3 of 8

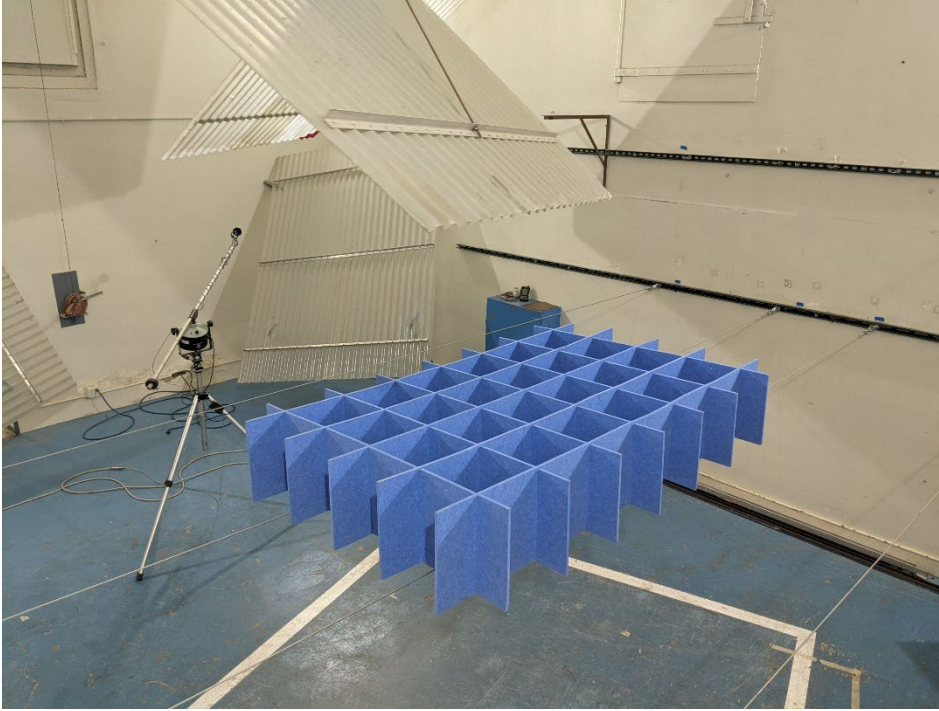


Figure 1 – Specimen mounted in test chamber

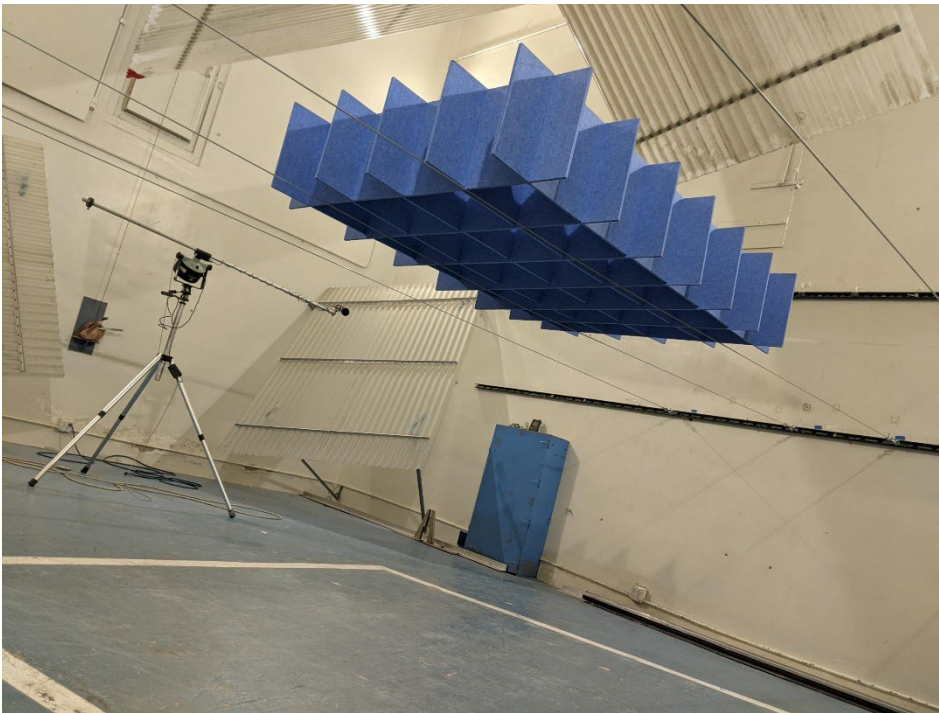


Figure 2 – Specimen mounted in test chamber

1512 S BATAVIA AVENUE  
GENEVA, IL 60134  
630-232-0104

**Test Report**

[www.riverbankacoustics.com](http://www.riverbankacoustics.com)

FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

**ARTIZIN™**  
2022-11-08

**RAL™-A22-488**  
Page 4 of 8

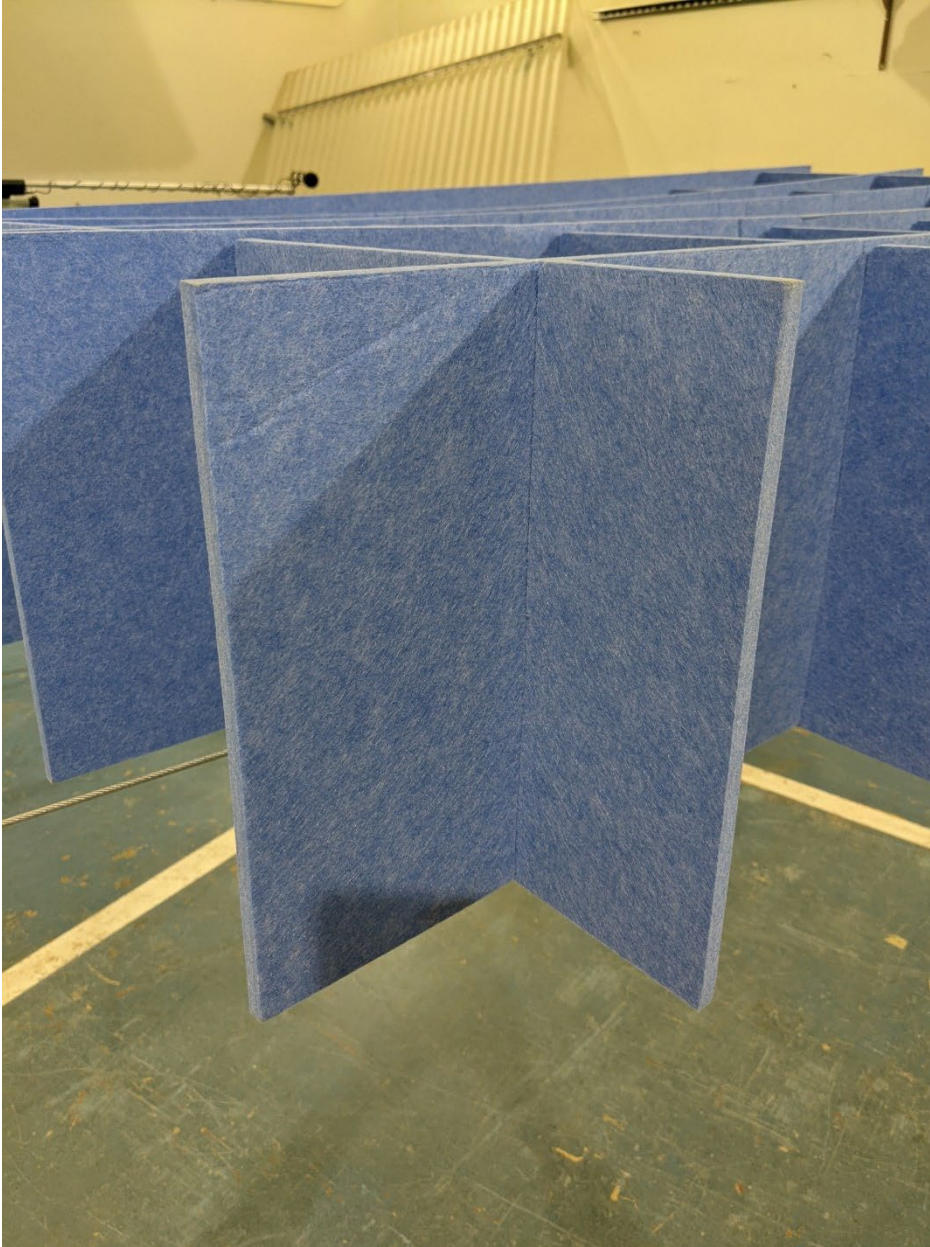


Figure 3 – Detail of specimen materials

1512 S BATAVIA AVENUE  
 GENEVA, IL 60134  
 630-232-0104

## Test Report

[www.riverbankacoustics.com](http://www.riverbankacoustics.com)

FOUNDED 1918 BY  
 WALLACE CLEMENT SABINE

**ARTIZIN™**  
 2022-11-08

**RAL™-A22-488**  
 Page 5 of 8


### TEST RESULTS

Note: There is currently no standardized method for calculating Absorption Coefficients from spaced object absorbers. The sound absorption performance of spaced object absorbers should not be compared directly with specimens tested as a single rectangular area (e.g. mounting types A, E, etc.).

1/3 Octave Center Frequency (Hz)	Total Absorption		Absorption per Object	
	(m <sup>2</sup> )	(Sabins)	(m <sup>2</sup> / Object)	(Sabins / Object)
100	0.28	3.01	0.28	3.01
** 125	0.87	9.32	0.87	9.32
160	0.95	10.27	0.95	10.27
200	1.26	13.51	1.26	13.51
** 250	2.02	21.73	2.02	21.73
315	2.53	27.27	2.53	27.27
400	2.71	29.21	2.71	29.21
** 500	2.85	30.66	2.85	30.66
630	3.00	32.30	3.00	32.30
800	2.96	31.89	2.96	31.89
** 1000	3.26	35.05	3.26	35.05
1250	3.57	38.39	3.57	38.39
1600	3.82	41.10	3.82	41.10
** 2000	4.13	44.44	4.13	44.44
2500	4.42	47.53	4.42	47.53
3150	4.80	51.64	4.80	51.64
** 4000	4.95	53.26	4.95	53.26
5000	4.97	53.47	4.97	53.47

Tested by   
 Marc Sciaky  
 Senior Experimentalist

Report by   
 Keith Kimberling  
 Test Engineer

Approved by   
 Eric P. Wolfram  
 Laboratory Manager



RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE  
GENEVA, IL 60134  
630-232-0104

Test Report


[www.riverbankacoustics.com](http://www.riverbankacoustics.com)

FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

ARTIZIN™  
2022-11-08

RAL™-A22-488  
Page 6 of 8

SOUND ABSORPTION REPORT  
ArtFelt™ Connex Cloud

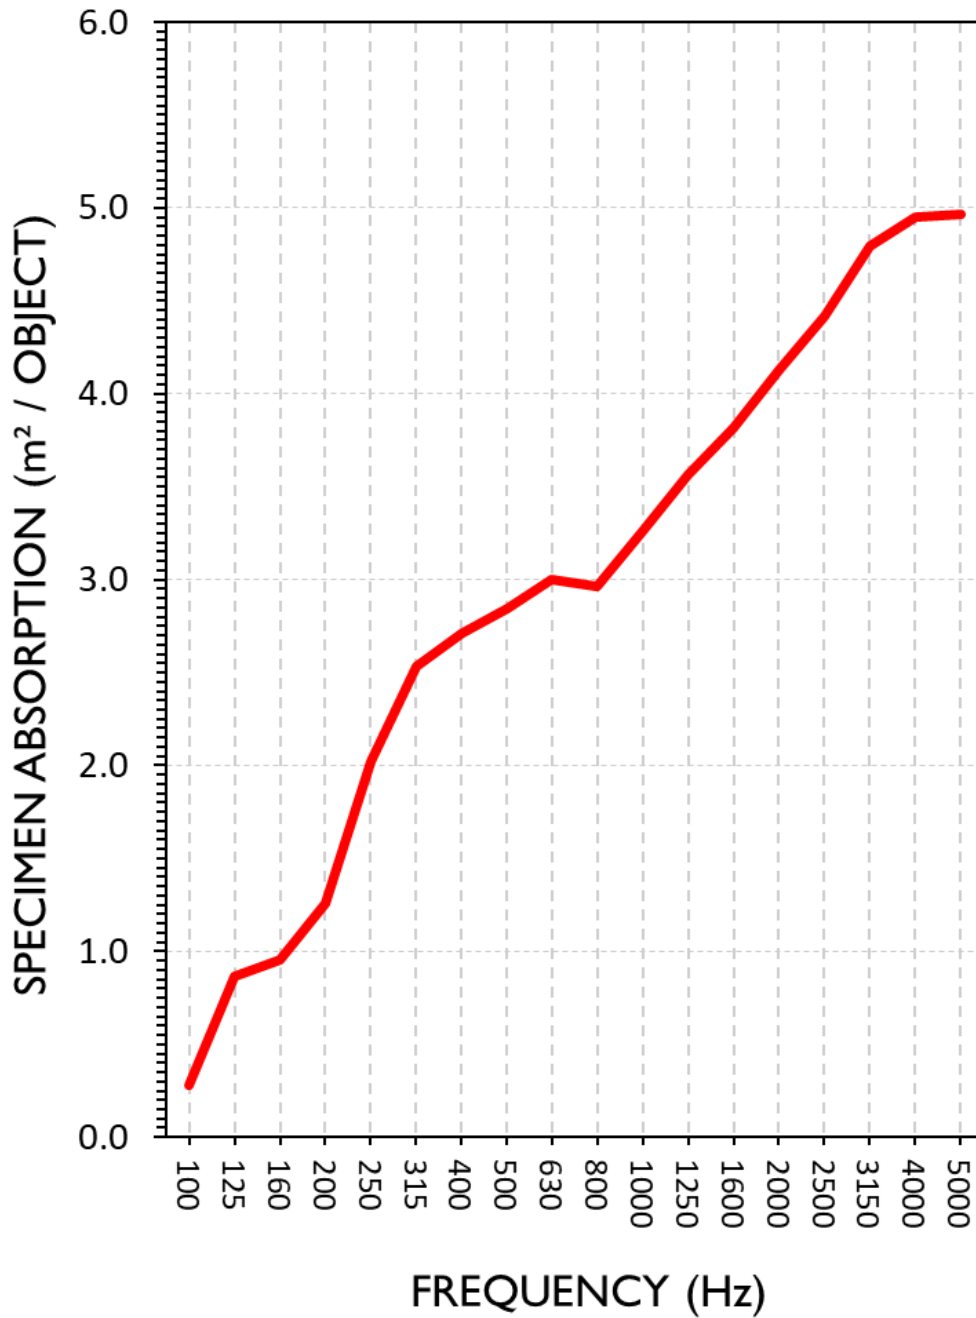

RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE  
 GENEVA, IL 60134  
 630-232-0104

## Test Report

[www.riverbankacoustics.com](http://www.riverbankacoustics.com)

FOUNDED 1918 BY  
 WALLACE CLEMENT SABINE

ARTIZIN™  
 2022-11-08

**RAL™-A22-488**  
 Page 7 of 8

### APPENDIX A: Extended Frequency Range Data

Specimen: ArtFelt™ Connex Cloud (See Full Report)

*The following non-accredited data were obtained in accordance with ASTM C423-22, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.*

1/3 Octave Band Center Frequency (Hz)	Total Absorption		Absorption per Object	
	(m <sup>2</sup> )	(Sabins)	(m <sup>2</sup> / Object)	(Sabins / Object)
31.5	-0.19	-2.06	-0.19	-2.06
40	-0.83	-8.89	-0.83	-8.89
50	0.43	4.66	0.43	4.66
63	-0.05	-0.53	-0.05	-0.53
80	0.86	9.26	0.86	9.26
100	0.28	3.01	0.28	3.01
125	0.87	9.32	0.87	9.32
160	0.95	10.27	0.95	10.27
200	1.26	13.51	1.26	13.51
250	2.02	21.73	2.02	21.73
315	2.53	27.27	2.53	27.27
400	2.71	29.21	2.71	29.21
500	2.85	30.66	2.85	30.66
630	3.00	32.30	3.00	32.30
800	2.96	31.89	2.96	31.89
1000	3.26	35.05	3.26	35.05
1250	3.57	38.39	3.57	38.39
1600	3.82	41.10	3.82	41.10
2000	4.13	44.44	4.13	44.44
2500	4.42	47.53	4.42	47.53
3150	4.80	51.64	4.80	51.64
4000	4.95	53.26	4.95	53.26
5000	4.97	53.47	4.97	53.47
6300	5.45	58.62	5.45	58.62
8000	5.74	61.76	5.74	61.76
10000	6.17	66.47	6.17	66.47
12500	6.49	69.89	6.49	69.89

1512 S BATAVIA AVENUE  
GENEVA, IL 60134  
630-232-0104

## Test Report

[www.riverbankacoustics.com](http://www.riverbankacoustics.com)

FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

ARTIZIN™  
2022-11-08

RAL™-A22-488  
Page 8 of 8

### APPENDIX B: Instruments of Traceability

Specimen: ArtFelt™ Connex Cloud (See Full Report)

<u>Description</u>	<u>Model</u>	<u>Serial Number</u>	<u>Date of Certification</u>	<u>Calibration Due</u>
System 1	Type 3160-A-042	3160-106968	2022-07-12	2023-07-12
Bruel & Kjaer Mic And Preamp C	Type 4943-B-001	2311439	2022-05-02	2023-05-02
Bruel & Kjaer Pistonphone	Type 4228	2781248	2022-07-22	2023-07-22
EXTECH Hygro 959	SD700	A099959	2022-03-22	2023-03-22

### APPENDIX C: Revisions to Original Test Report

Specimen: ArtFelt™ Connex Cloud (See Full Report)

<u>Date</u>	<u>Revision</u>
2022-11-11	Original report issued

---

END



SPONSOR: **ARTIZIN™**  
Garland, TX

Report Referenced: **RAL™-A22-488**  
Page 1 of 3

CONDUCTED: 2022-11-08

ON: ArtFelt™ Connex Cloud (See Full Test Report for Details)

### **Appendix D to ASTM C423 Sound Absorption Test**

Non-standard calculation of equivalent NRC Rating and Absorption Coefficients from spaced absorbers

At this time, ASTM C423 does not provide a standard method for determining absorption coefficients of spaced object absorbers. Tests of a set of sound absorbing objects spaced apart from each other will yield higher absorption rates than a specimen joined together as a single patch (A-Mount or E-Mount). For this reason it is unfair to provide NRC or absorption coefficient ratings for specimens that consist of a spaced set of absorbers. Despite this, the architectural industry has expressed great demand for a simple "single number" rating for these treatments. Likewise, acoustical consultants desire equivalent absorption coefficient data for use in acoustical modeling software. The following is an attempt to appease these demands until ASTM develops a standard method for calculation. Several alternate non-standard calculation methods are provided. Riverbank Acoustical Laboratories prefers method 1. Rating titles for these methods are prepended with the word "Apparent". These rating names and their associated acronyms are provided by RAL and shall not be misconstrued as originating from any current standard.

#### **Method 1) Apparent Sound Absorption Coefficient calculated from extended test specimen envelope**

The total sound absorption yielded by the specimen is divided by the surface area of the test surface covered by the suspended objects, including intermediate spaces, with additional added area to allow theoretical extrapolation for larger arrays. This method is not applicable in this case. Apparent sound absorption coefficients, and subsequently the Apparent Noise Reduction Coefficient (A\*NRC) and Apparent Sound Absorption Average (A\*SAA) ratings, are calculated using this surface area based on the methods described in ASTM C423-17. This may be the most accurate method for comparing object arrays to ceiling tile products. The apparent sound absorption coefficient data can be assigned to a single horizontal surface or plane in acoustical modeling software for approximation of object array performance. Such approximations rely on the assumptions that object spacing is similar to that of the tested array across the entire surface, that gaps are negligibly small between adjacent rows of objects if the test specimen consists of a single row, and that the installation occurs over a perfectly reflective surface material.

#### **Method 2) Apparent Sound Absorption Coefficient calculated from total exposed surface area of specimen**

The total sound absorption yielded by the specimen is divided by the total surface area of all exposed specimen faces. This method is not applicable in this case. Apparent sound absorption coefficients, and subsequently the Apparent Noise Reduction Coefficient (A\*NRC) and Apparent Sound Absorption Average (A\*SAA) ratings, are calculated using this surface area based on the methods described in ASTM C423-17. This method shows the actual absorption occurring at the exposed surfaces but does not provide a fair comparison with materials mounted as a uniform patch (in A-mount or E-mount).

## Appendix D (continued)

### **Method 3) Apparent Sound Absorption Coefficient calculated from one face per object**

The total sound absorption yielded by the specimen is divided by the surface area of one side of one large face for each object in the specimen. This method is not applicable in this case. Apparent sound absorption coefficients, and subsequently the Apparent Noise Reduction Coefficient (A\*NRC) and Apparent Sound Absorption Average (A\*SAA) ratings, are calculated using this surface area based on the methods described in ASTM C423-17. This method is favored by some material manufacturers since it yields very high NRC figures, but does not provide a fair comparison with other ceiling tile or wall panel products. Riverbank Acoustical Laboratories recommends that results obtained from this method be used for research and comparison purposes only; such results should not be used for marketed claims of product performance.

### **Method 4) Apparent Sound Absorption Coefficient calculated from specimen envelope without extension**

The total sound absorption yielded by the specimen is divided by the rectangular test surface area covered by the suspended objects, including intermediate spaces. The object rigging covered 2.18 m<sup>2</sup> (23.5 ft<sup>2</sup>) of horizontal test surface area. Apparent sound absorption coefficients, and subsequently the Apparent Noise Reduction Coefficient (A\*NRC) and Apparent Sound Absorption Average (A\*SAA) ratings, are calculated using this surface area based on the methods described in ASTM C423-17. While similar in concept to Method 1, attempting to model any array larger than the tested specimen using these results would imply instances of adjacent objects with zero spacing scattered throughout the extrapolated array. Riverbank Acoustical Laboratories recommends that results obtained from this method be used for research and comparison purposes only; such results should not be used for marketed claims of product performance.

ARTIZIN™  
2022-11-08

Report Referenced: **RAL™-A22-488**

Page 3 of 3

**Appendix D: Data** Note: See full test report for details of mounting position, spacing, and configuration, as these parameters greatly affect sound absorption performance.

Specimen Absorption (ft <sup>2</sup> )			Method 1	Method 2	Method 3	Method 4
Freq. (Hz)	Sabins	Sabins / Object	Apparent Abs. Coefficient From Total Coverage Area (N/A)	Apparent Abs. Coefficient From Total Exposed Surface Area (N/A)	Apparent Abs. Coefficient From One Face per Object (N/A)	Apparent Abs. Coefficient From Unextended Envelope Area (23.5 ft <sup>2</sup> )
31.5	-2.06	-2.06	N/A	N/A	N/A	-0.09
40	-8.89	-8.89	N/A	N/A	N/A	-0.38
50	4.66	4.66	N/A	N/A	N/A	0.20
<b>63</b>	-0.53	-0.53	N/A	N/A	N/A	-0.02
80	9.26	9.26	N/A	N/A	N/A	0.39
100	3.01	3.01	N/A	N/A	N/A	0.13
<b>125</b>	9.32	9.32	N/A	N/A	N/A	0.40
160	10.27	10.27	N/A	N/A	N/A	0.44
200	13.51	13.51	N/A	N/A	N/A	0.57
<b>250</b>	21.73	21.73	N/A	N/A	N/A	0.92
315	27.27	27.27	N/A	N/A	N/A	1.16
400	29.21	29.21	N/A	N/A	N/A	1.24
<b>500</b>	30.66	30.66	N/A	N/A	N/A	1.30
630	32.30	32.30	N/A	N/A	N/A	1.37
800	31.89	31.89	N/A	N/A	N/A	1.36
<b>1,000</b>	35.05	35.05	N/A	N/A	N/A	1.49
1,250	38.39	38.39	N/A	N/A	N/A	1.63
1,600	41.10	41.10	N/A	N/A	N/A	1.75
<b>2,000</b>	44.44	44.44	N/A	N/A	N/A	1.89
2,500	47.53	47.53	N/A	N/A	N/A	2.02
3,150	51.64	51.64	N/A	N/A	N/A	2.20
<b>4,000</b>	53.26	53.26	N/A	N/A	N/A	2.27
5,000	53.47	53.47	N/A	N/A	N/A	2.28
6,300	58.62	58.62	N/A	N/A	N/A	2.49
<b>8,000</b>	61.76	61.76	N/A	N/A	N/A	2.63
10,000	66.47	66.47	N/A	N/A	N/A	2.83
12,500	69.89	69.89	N/A	N/A	N/A	2.97
<b>Apparent NRC:</b>			<b>N/A</b>	<b>N/A</b>	<b>N/A</b>	<b>1.40</b>
<b>Apparent SAA:</b>			<b>N/A</b>	<b>N/A</b>	<b>N/A</b>	<b>1.39</b>

Prepared by   
Keith Kimberling  
Test Engineer